


NOTE(S): ① SHOWS ORIENTATION OF  
MOTORIZED PILOT. INSTALL  
ACCORDING TO CLA-VAL  
CO. INSTRUCTIONS

2 NECESSARY PLUMBING  
CHANGES TO BE MADE  
ACCORDING TO CLA-VAL  
INSTRUCTION

③ ISOLATION VALVE CLA-VAL  
CK2

TOP SIDE

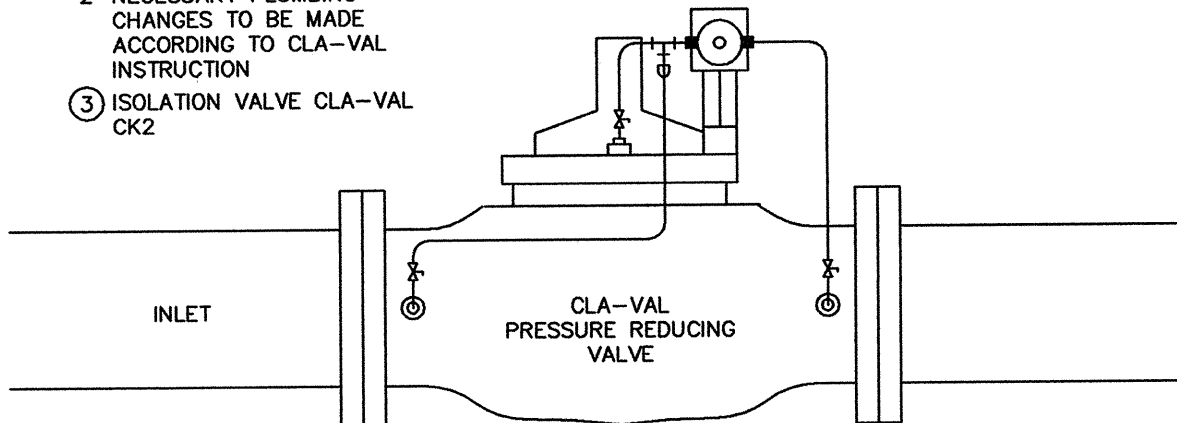


SIDE VIEW

DETAIL C

PILOT VALVE ACTUATOR MOUNTING

NOTE(S): ① ASHCROFT SERIES 1009  
GAUGE SHALL BE MOUNTED  
40" MIN FROM VAULT FLOOR

② BLOCK & BLEED VALVES  
SHALL BE 1/2"  
STAINLESS STEEL  
BALL VALVES  
JAMESBURY SERIES  
1000

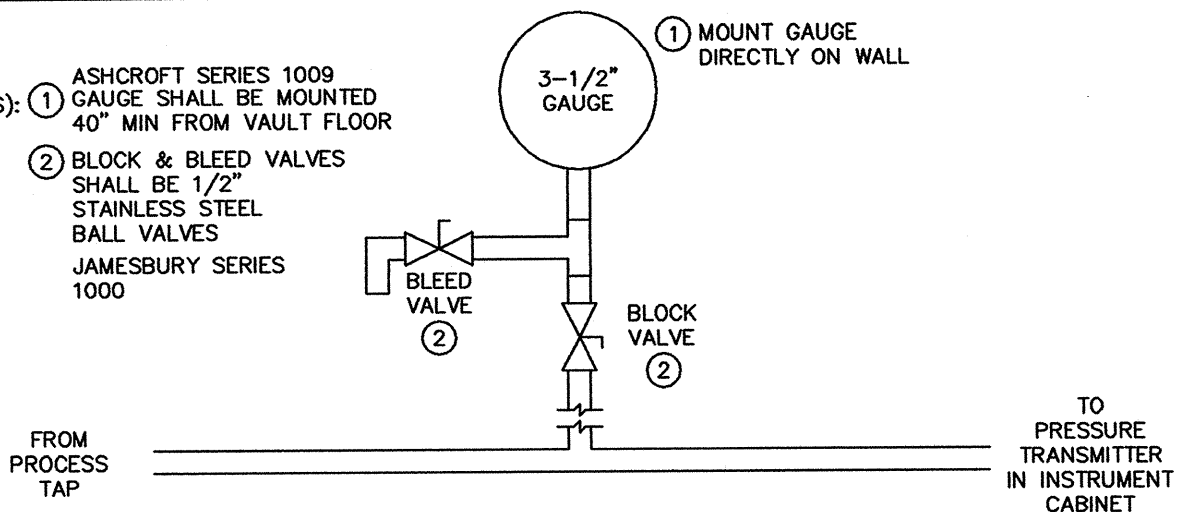

DETAIL D

PRESSURE GAUGE MOUNTING

REV. 2004

CITY OF COLUMBUS, OHIO  
DEPARTMENT OF PUBLIC UTILITIES  
DIVISION OF WATER

APPROVED

*RC Westerfield* 1-21-05  
ADMINISTRATOR DATE

PRESSURE REDUCING VALVE PANELS  
GENERAL  
DETAILS

